


Dipswitch Settings	OFF	ON
1. Safety Output	N.O.	N.C.
2. Stall Output	N.O.	N.C.
3. Auto / K.A.	Automatic	Knowing Act
4. Future Use		

Tables for 904 dipswitch settings

Fully Automatic	Knowing Act
1. OFF	1. OFF
2. ON	2. ON
3. OFF	3. ON
4. OFF	4. OFF



NOTE:
For Knowing Act applications all activating devices must connect to the purple wires of the OC-904 controls (N.O. dry contact only).

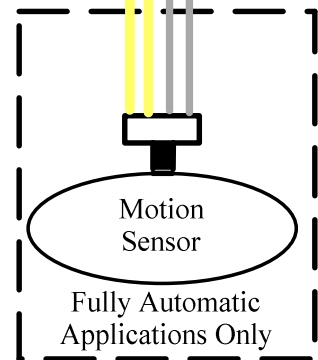

- INSTALLATION NOTES**
1. Set door speeds and verify proper door operation prior to final connections of sensors system.
 2. Technician MUST WALK TEST to verify function and detection patterns comply with ANSI/BHMA A156.10 requirements.

Title: Hunter FA-8 Single with Elite		Drawing # 01HUNFA8ELI01
Drawing By: SDR	Date: 01-31-08	Sheet: 1 of 1
Optex Technologies Inc. 3882 Del Amo Blvd., Suite 604, Torrance, CA 90503 Office: (800)877-6656, Fax: (310)214-8655		